

- 1.08 -		
Sprcha	11,1 m ³	
3,8 m ²		592 W
24 °C		

- 1.07 -		
WC zamestnancov	9,1 m ³	
3,2 m ²		88 W
15 °C		

- 1.06 -		
Technická miestnosť	29,8 m ³	
10,3 m ²		680 W
15 °C		

- 1.05 -		
Kuchynka pre zamestnancov	41,3 m ³	
14,3 m ²		1181 W
20 °C		


- 1.09 -		
Sociálne zariadenie	20,1 m ³	
6,9 m ²		365 W
15 °C		

- 1.02 -		
Chodba	67,5 m ³	
23,3 m ²		818 W
18 °C		

- 1.12 -		
WC imobilný	8,4 m ³	
2,9 m ²		292 W
20 °C		

- 1.16 -		
Skoliaca miestnosť	181,8 m ³	
62,7 m ²		2798 W
20 °C		

Vst		
9,4 m		
15 °		

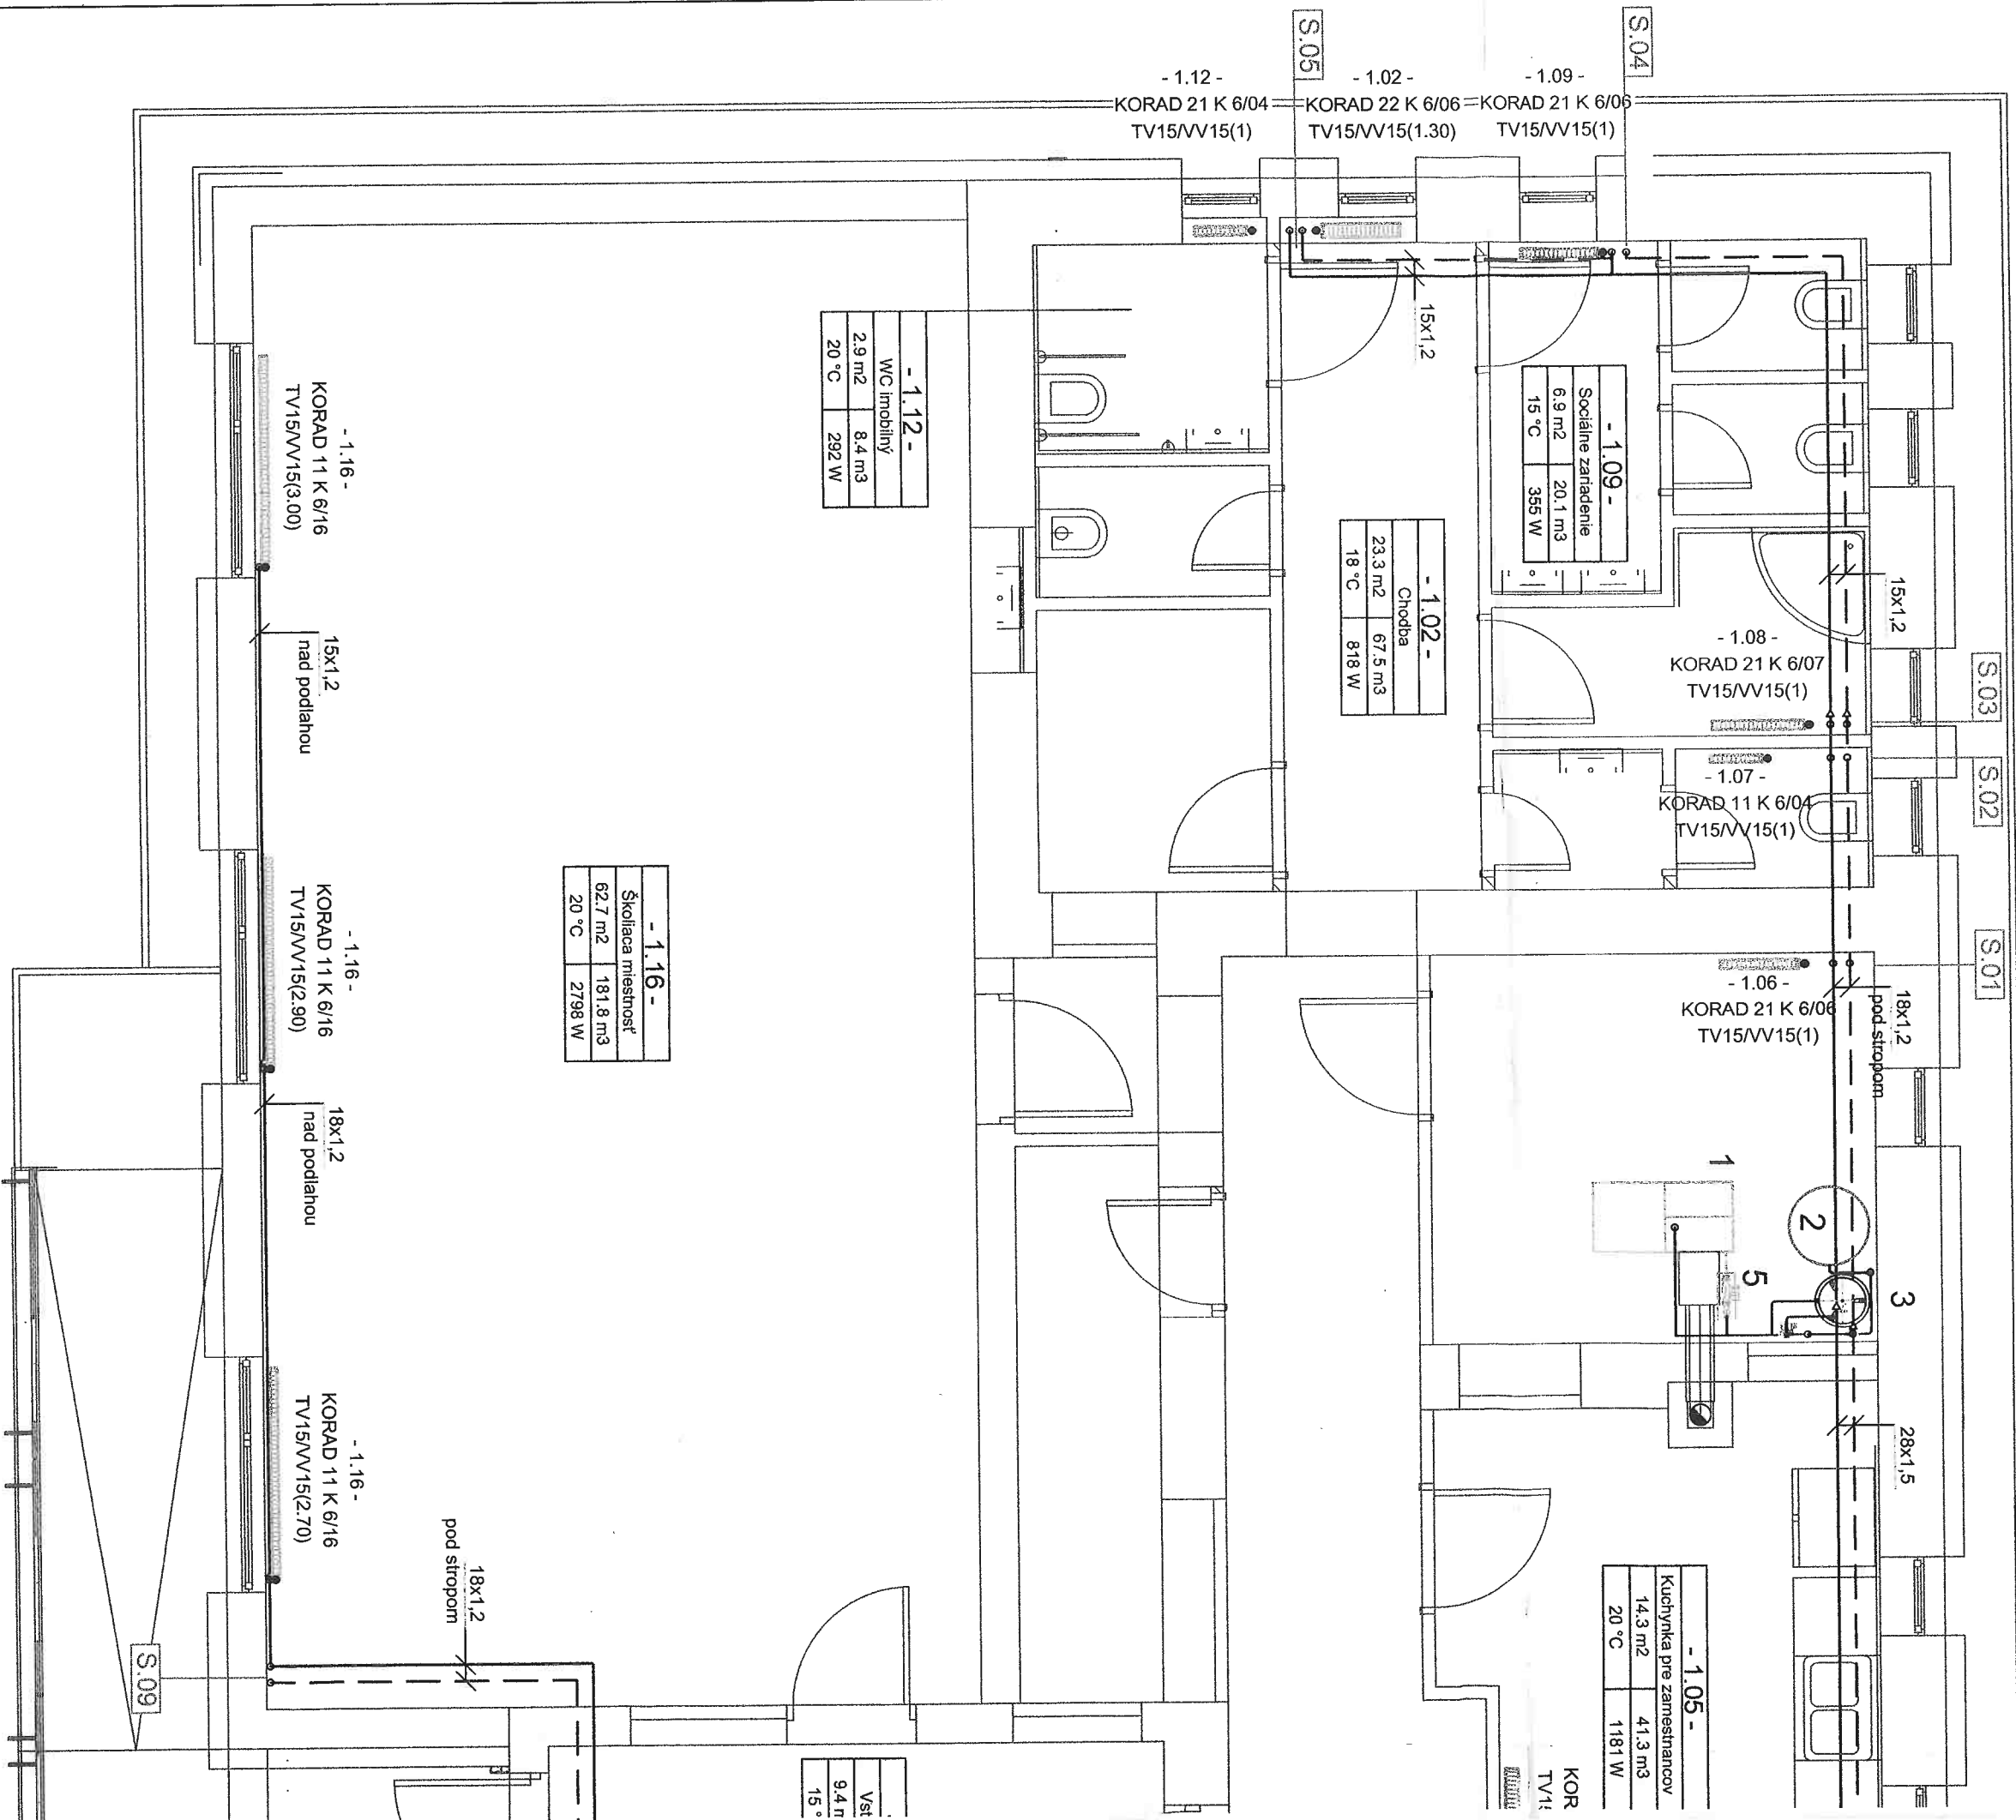

- 1.12 - KORAD 21 K 6/04 TV15/VV15(1)
 - 1.02 - KORAD 22 K 6/06 TV15/VV15(1.30)
 - 1.09 - KORAD 21 K 6/06 TV15/VV15(1)

- 1.16 - KORAD 11 K 6/16 TV15/VV15(3.00)

15x1,2 nad podlahou

- 1.16 - KORAD 11 K 6/16 TV15/VV15(2.90)

18x1,2 nad podlahou

- 1.16 - KORAD 11 K 6/16 TV15/VV15(2.70)

18x1,2 pod stropom

S.09

S.04

S.05

S.03

S.02

S.01

- 1.06 - KORAD 21 K 6/06 TV15/VV15(1)
 18x1,2 pod stropom

1
2
3
4
5

28x1,5

KOR TV15